


FIV diagnostic algorithm—all cats

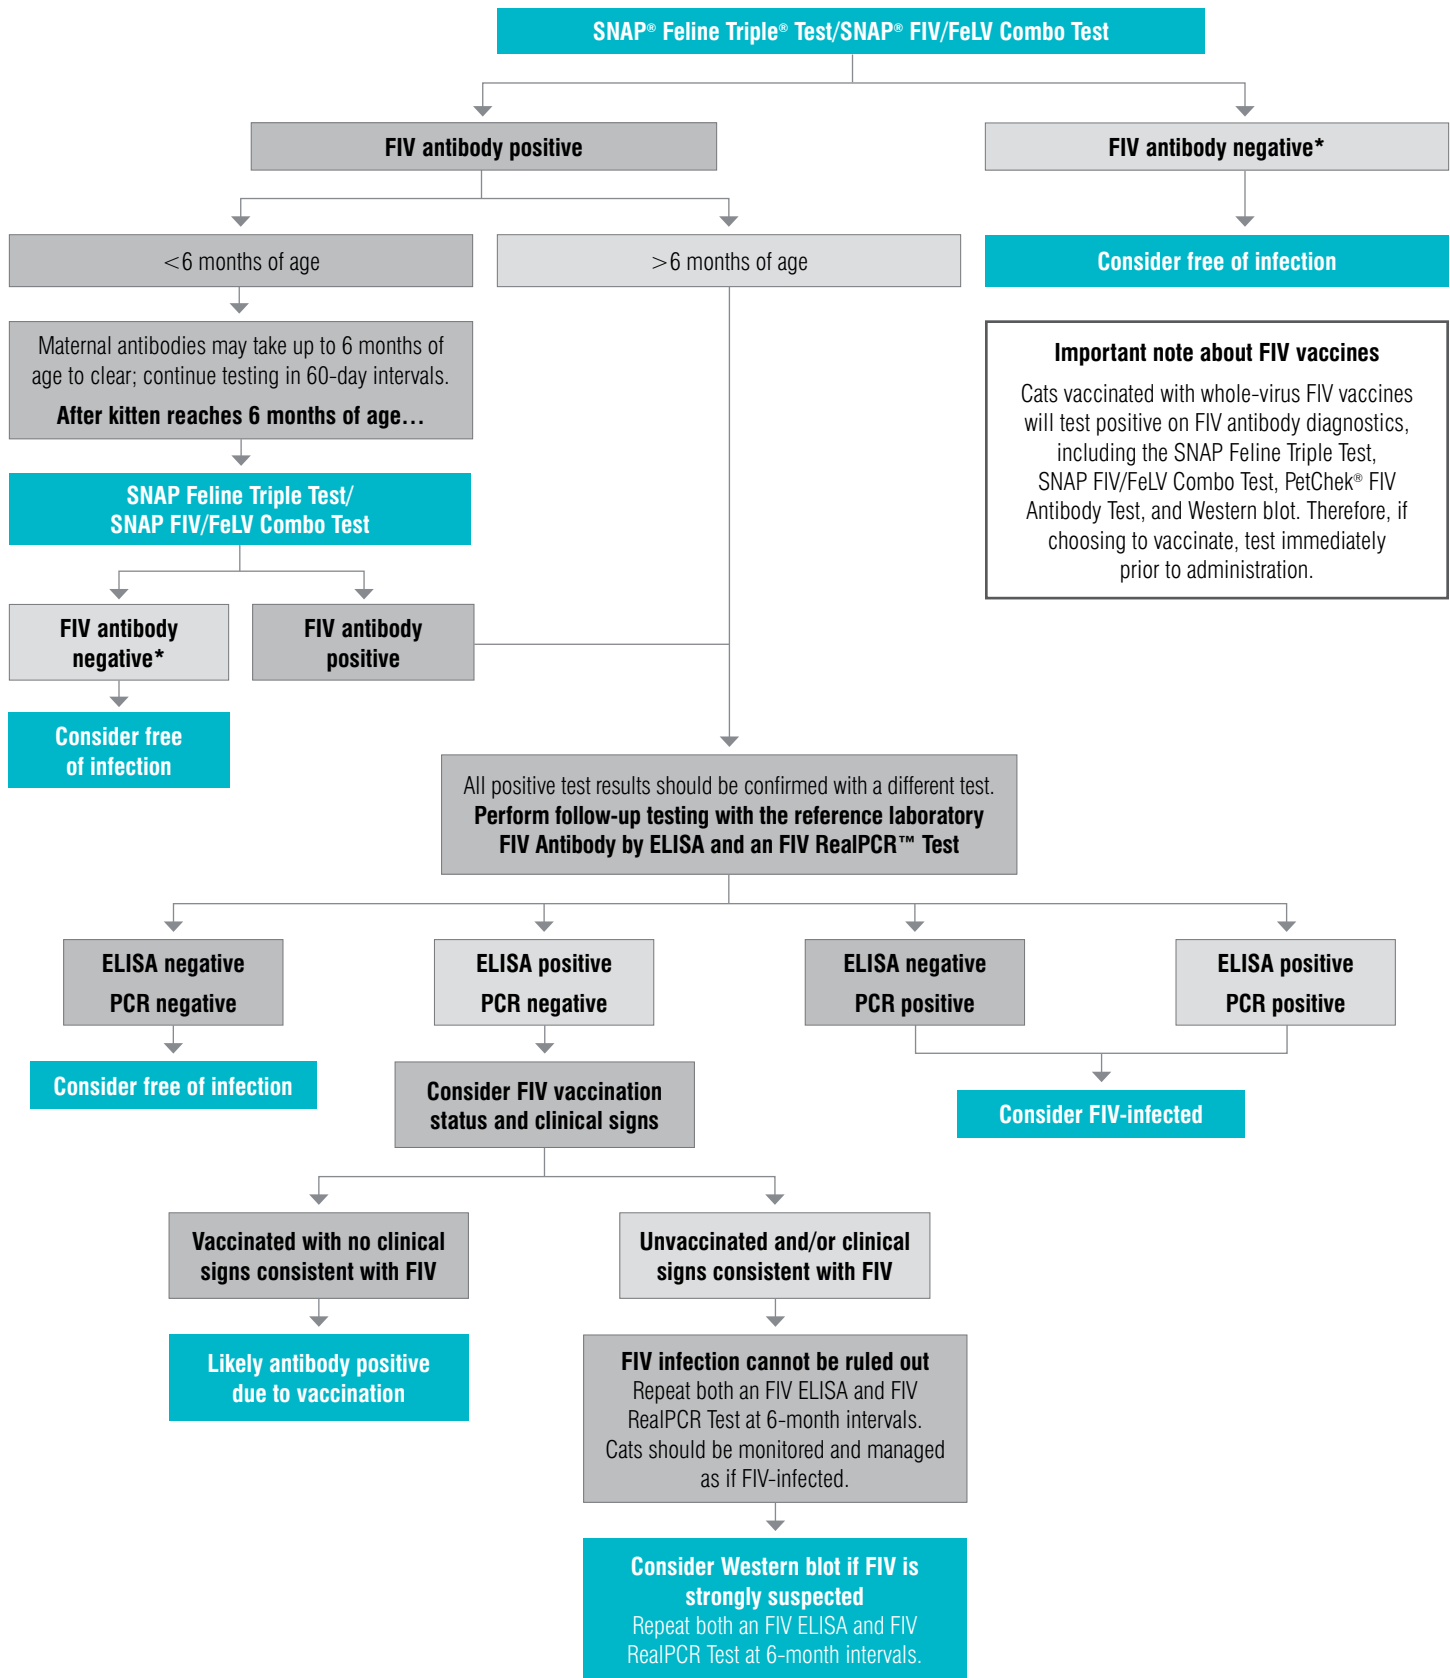

*Cats receiving negative results should be retested a minimum of 60 days after their last potential exposure to allow FIV antibody to reach detectable levels.